


NOTES:

1. MANHOLE RIMS ARE TO BE FLUSH WITH PAVEMENT IN PAVED AREAS.
2. MANHOLE RIMS ON OUTFALL LINES ARE TO BE 18" ABOVE GROUND.
3. MANHOLE RIMS IN FUTURE STREETS ARE TO BE 48" ABOVE GROUND.
4. SEE DETAIL S704 REGARDING SAFETY PLATFORMS.
5. SEE DETAIL S730 REGARDING LAST MANHOLE ON SEWER LINE BEFORE A WET WELL.

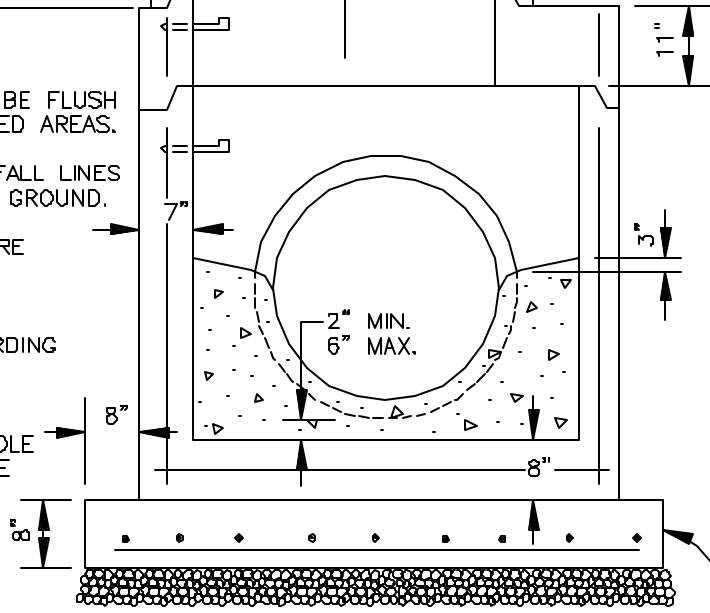

8" FOOTING REQUIRED ON DEPTHS OF 16 FEET AND OVER WITH NO.4 BARS AT 12" O.C.E.W. ON A 6" GRANULAR FOUNDATION.

**CHEROKEE COUNTY
WATER & SEWERAGE
AUTHORITY**

**STANDARD
VENTED MANHOLE**
(FOR PIPE LARGER THAN 18")
CONSTRUCTION STANDARD

DATE: FEB. '03

APPROVED:

STANDARD
NO.
S702