


NOTE:

Meter box must be supported with compacted soil, gravel, etc. to keep top of box from settling below finished grade.
Bricks can be used but should not be placed on top of water lines.

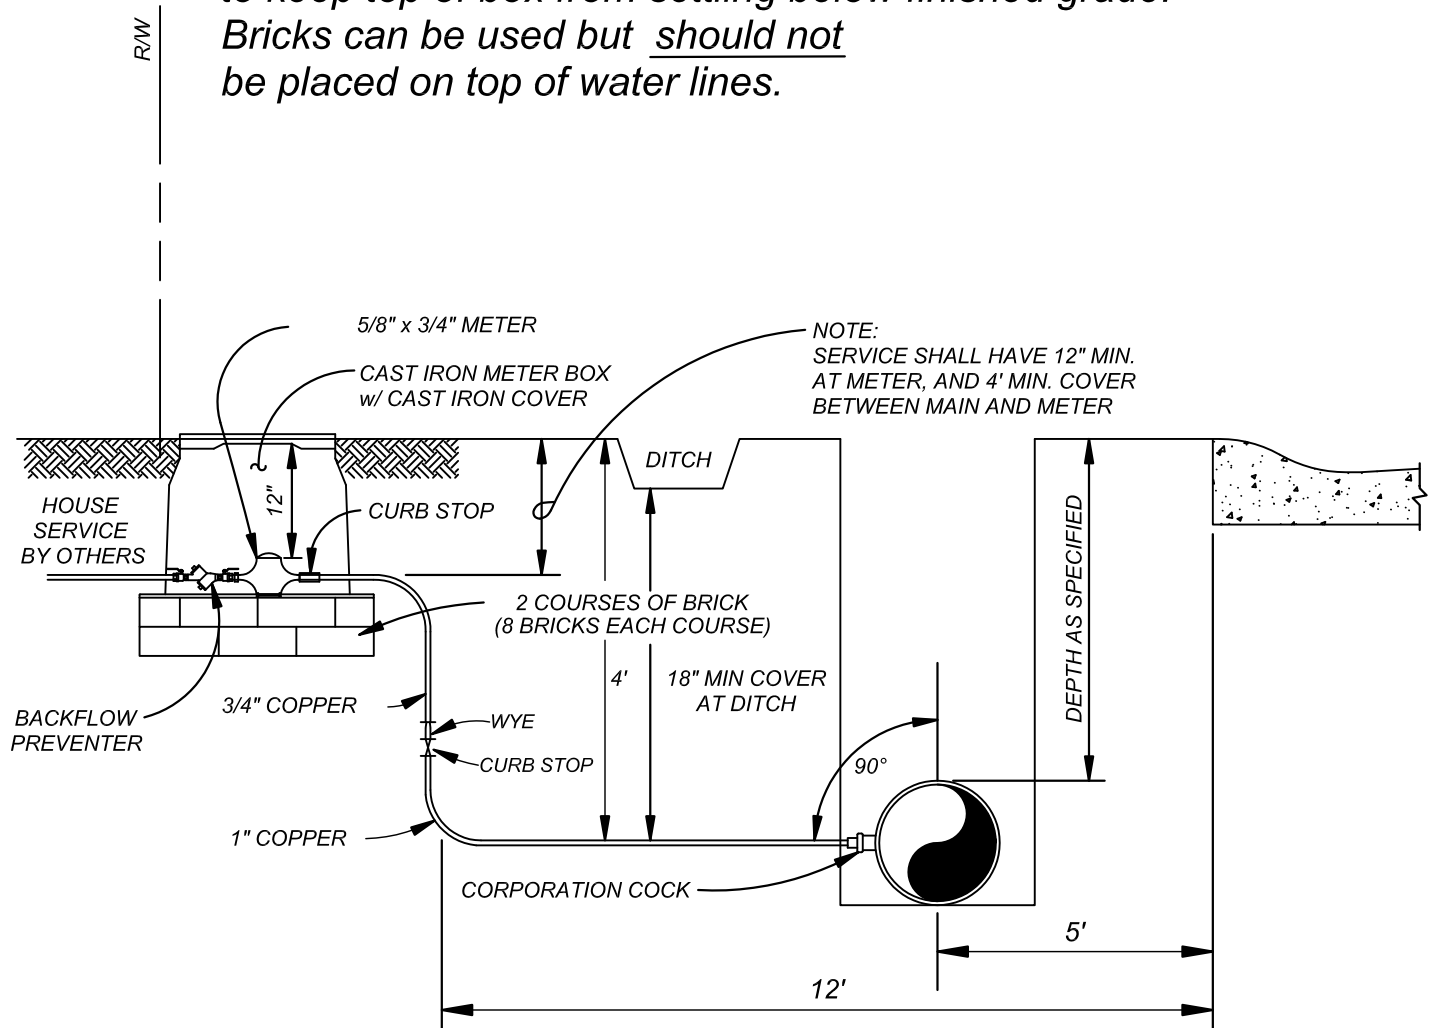

NOTES:

1. SERVICE LINE SHALL BE 3/4" FROM MAIN WHEN ONLY ONE 3/4" SERVICE IS REQUIRED.
2. USE ALL COMPRESSION JOINTS.
3. INSTALLATION SHALL ALLOW ADEQUATE ROOM TO REMOVE AND/OR REPAIR METER.

HOUSE SERVICE INSTALLATION

**CHEROKEE COUNTY
WATER & SEWERAGE
AUTHORITY**

**HOUSE SERVICE
INSTALLATION**

CONSTRUCTION STANDARD

DATE:	FEB. '03
Revised	'07
APPROVED:	

STANDARD NO.

W707