


CONTACTS WITH CCWSA  
 RICKY DOBBS - 770-479-9107 EX. 221  
 RODNEY SATTERFIELD - 770-479-9107 EX. 225  
 RON TEHAN - 770-479-9107 EX. 223  
 MARTY RODGERS - 770-479-9107 EX. 227  
 KEITH ALLEN - 770-479-9107 EX. 226  
 GREG LONG - 770-479-9107 EX. 228

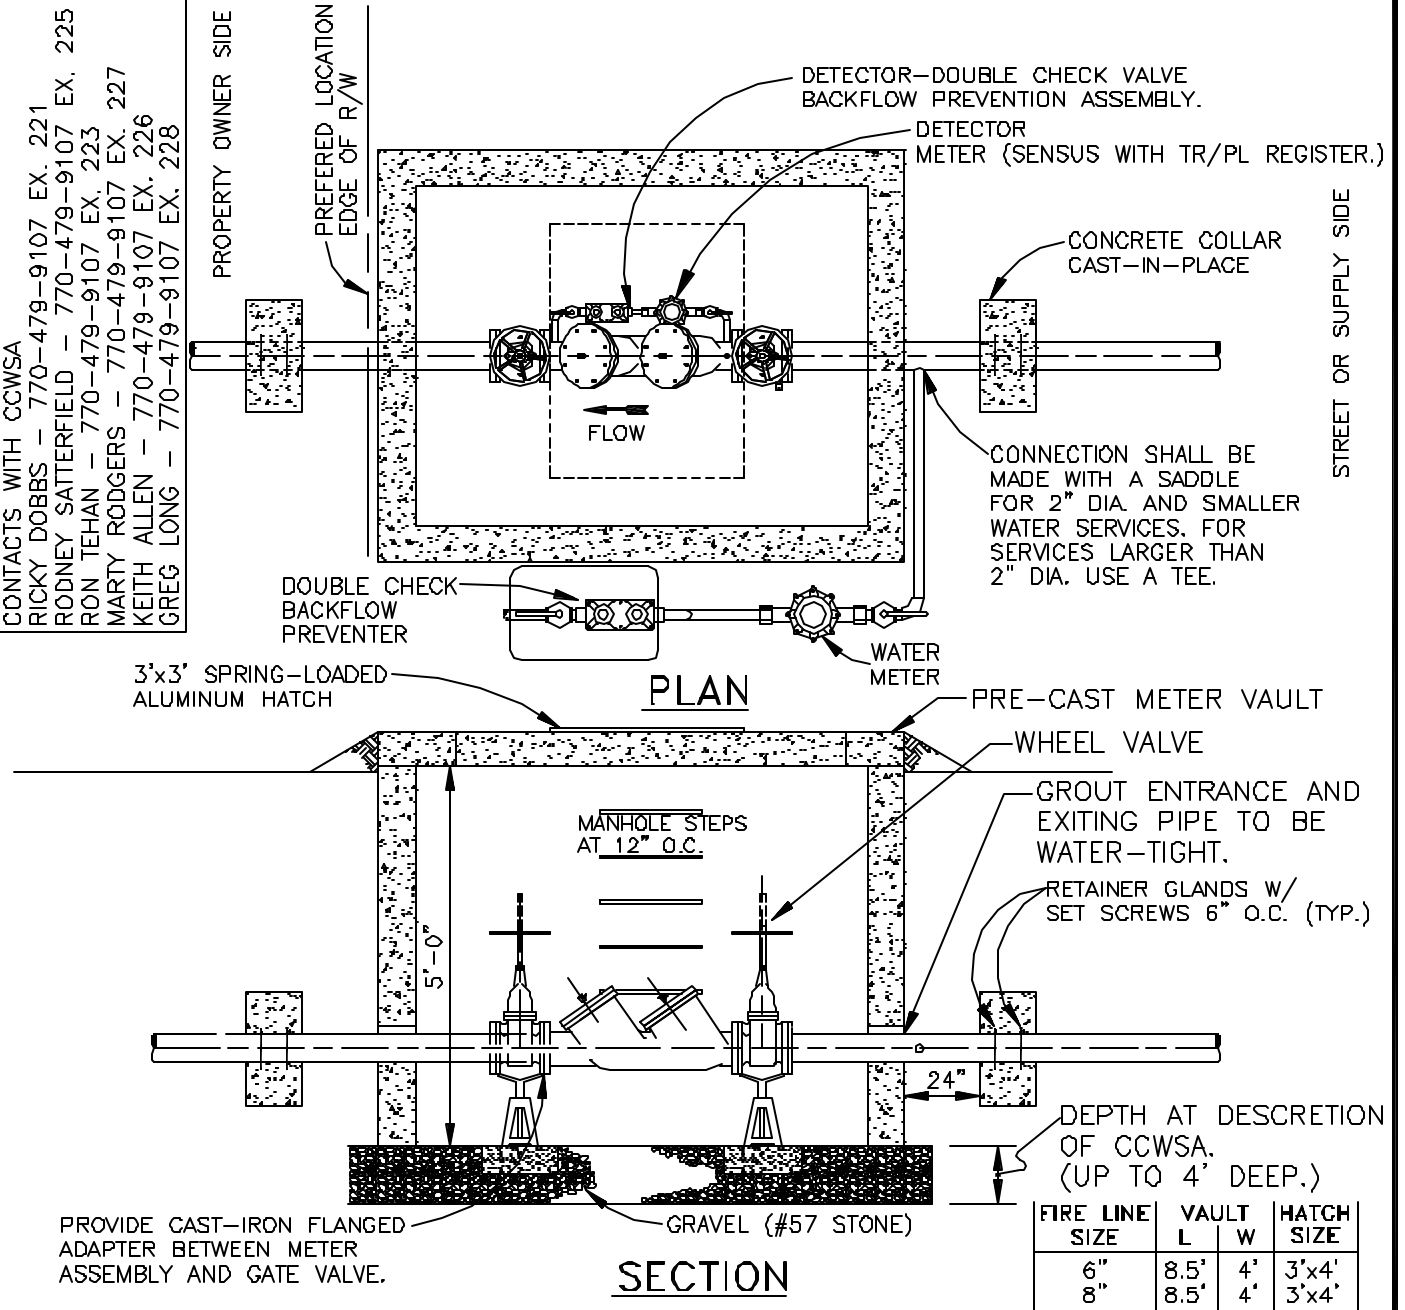

- NOTES:**
1. BOXES EXCEEDING 5' IN DEPTH MUST BE APPROVED BY THE AUTHORITY.
  2. WHEN METER BOX CANNOT BE LOCATED ENTIRELY ON R/W, A PERMANENT EASEMENT SHALL BE OBTAINED TO PREVENT FENCES OR OTHER OBSTRUCTION FROM BEING ERRECTED AROUND THE METER BOX.
  3. COVER OPENING & STEPS TO BE PLACED NEAREST THE METER REGISTER.
  4. THESE BOXES ARE NOT TO BE INSTALLED IN TRAFFIC AREAS WITHOUT PRIOR PERMISSION FROM THE AUTHORITY.
  5. ALL VALVES AND FITTINGS INSIDE THE VAULT SHALL BE FLANGED.
  6. REDUCED PRESSURE DETECTOR ASSEMBLY (RPDA) REQUIRED WHEN THE DANGER FROM BACKFLOW PRESENTS A HEALTH HAZARD. ALL RPDA'S SHALL BE INSTALLED IN VAULTS SET ABOVE THE GROUND WITH DRAINS.
  7. SEE APPENDIX FOR AUTHORITY'S CROSS-CONNECTION CONTROL PROGRAM AND DETAILS.
  8. CCWSA WILL NOT ACCEPT AIMES BACKFLOW PREVENTERS.
  9. ANY DOMESTIC OR SPRINKLER METERS REQUIRED ARE TO BE TAPPED ON NEW LINE BETWEEN STREET AND VAULT WITH COPPER AND BRASS FITTINGS.
  10. NO METERS WILL BE SET UNTIL ALL FEES HAVE BEEN PAID AND ALL BACKFLOW TESTS ARE COMPLETE. SEWER INSPECTIONS MUST BE COMPLETED BEFORE ANY METERS ARE SET.

<b>CHEROKEE COUNTY          WATER &amp; SEWERAGE          AUTHORITY</b>	<b>DETECTOR/WATER          METERS AND          VAULT</b> CONSTRUCTION STANDARD	DATE: FEB. '03	STANDARD NO. W710
		APPROVED:	