
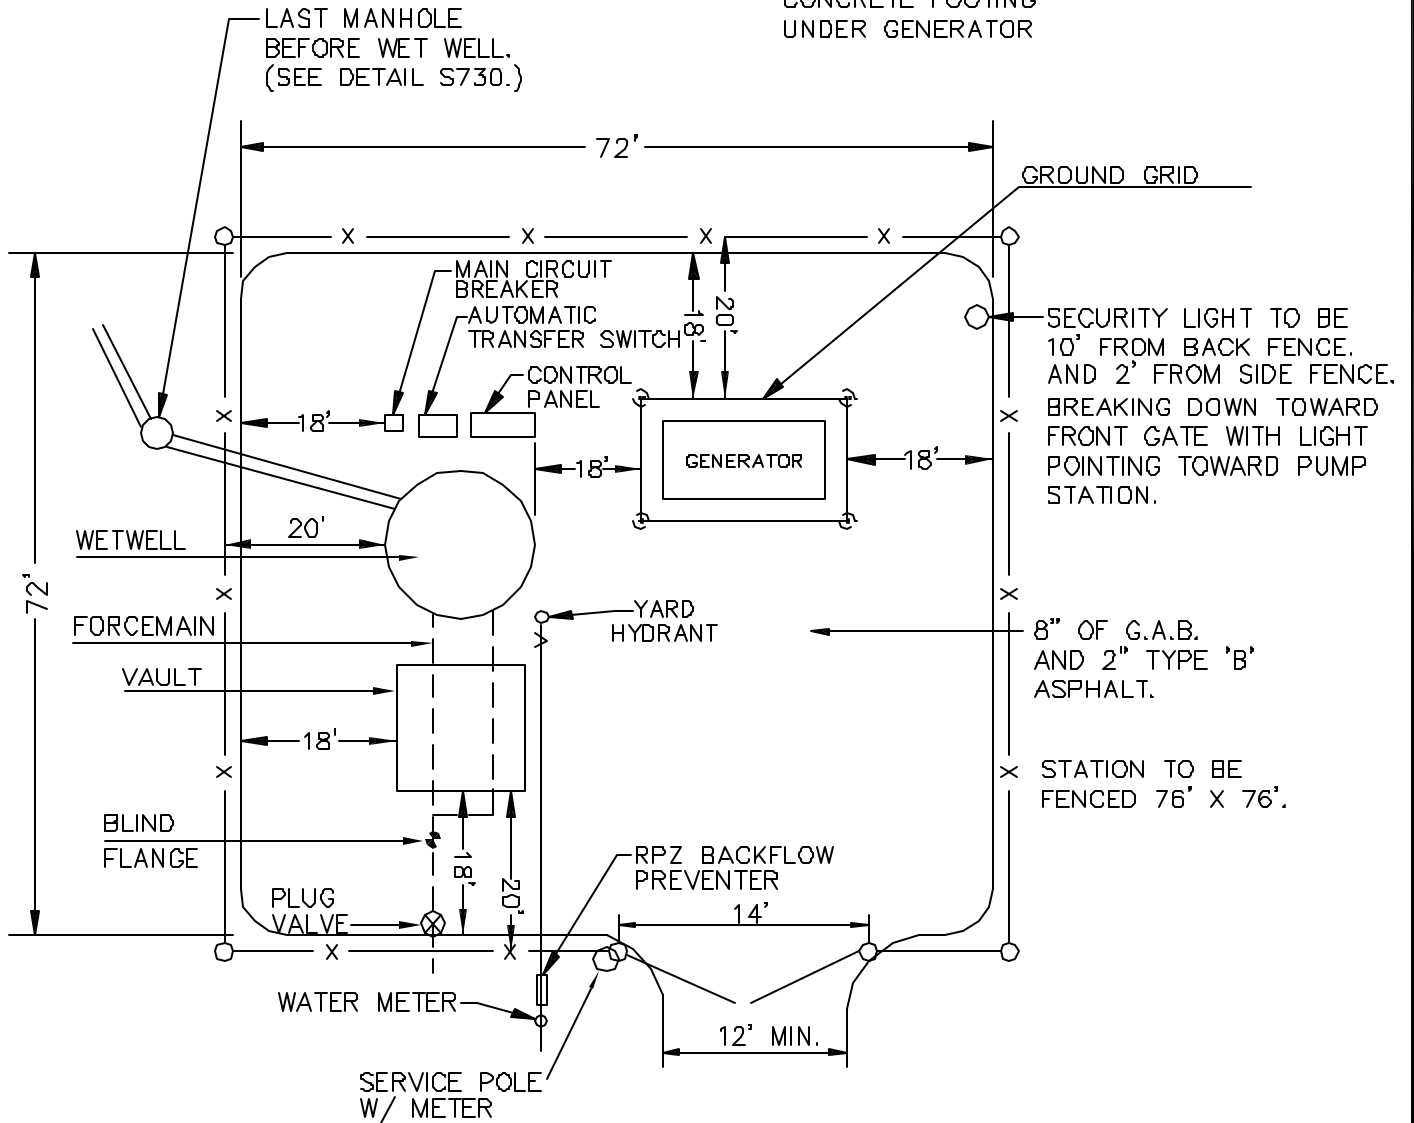


NOTES:

1. FLOOR OF CHECK VALVE VAULT TO BE SLOPED TO DRAIN WET WELL.
2. FLOOR DRAIN SHALL HAVE P-TRAP TO BLOCK GASES FROM WET WELL.
3. GENERATOR AND CONTROL PANEL TO BE FIELD LOCATED BY CCWSA.

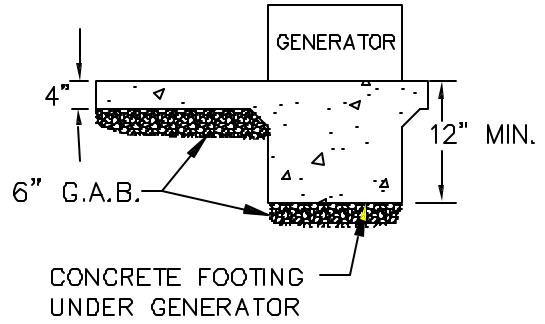

NOTE: THIS IS A GENERAL SCHEMATIC LAYOUT. LOCATIONS MAY VARY ACCORDING TO EQUIPMENT SIZE AND SITE REQUIREMENTS. NEED TO BE ABLE TO GET A TRUCK ON BOTH SIDES OF WET WELL AND GENERATOR. FOR DETAILED REQUIREMENTS, SEE SECTION 319 OF SANITARY SEWER STANDARDS.

**CHEROKEE COUNTY
WATER & SEWERAGE
AUTHORITY**

**SUBMERSIBLE
SITE
LAYOUT PLAN
CONSTRUCTION STANDARD**

DATE:	FEB. '03
APPROVED:	

STANDARD NO.
S729