NOTES:

1. DEVELOPER MAINTAINS AND CLEANS OUT THIS MANHOLE FOR ONE YEAR AFTER LIFT STATION IS PUT INTO OPERATION.
2. AFTER ONE YEAR OF SERVICE, DEVELOPER SHALL RETURN TO BUILD NORMAL INVERT IN MANHOLE FLUSH WITH PIPING.
3. SEE DETAIL S701 FOR REQUIREMENTS REGARDING MANHOLE AND RING CONSTRUCTION.

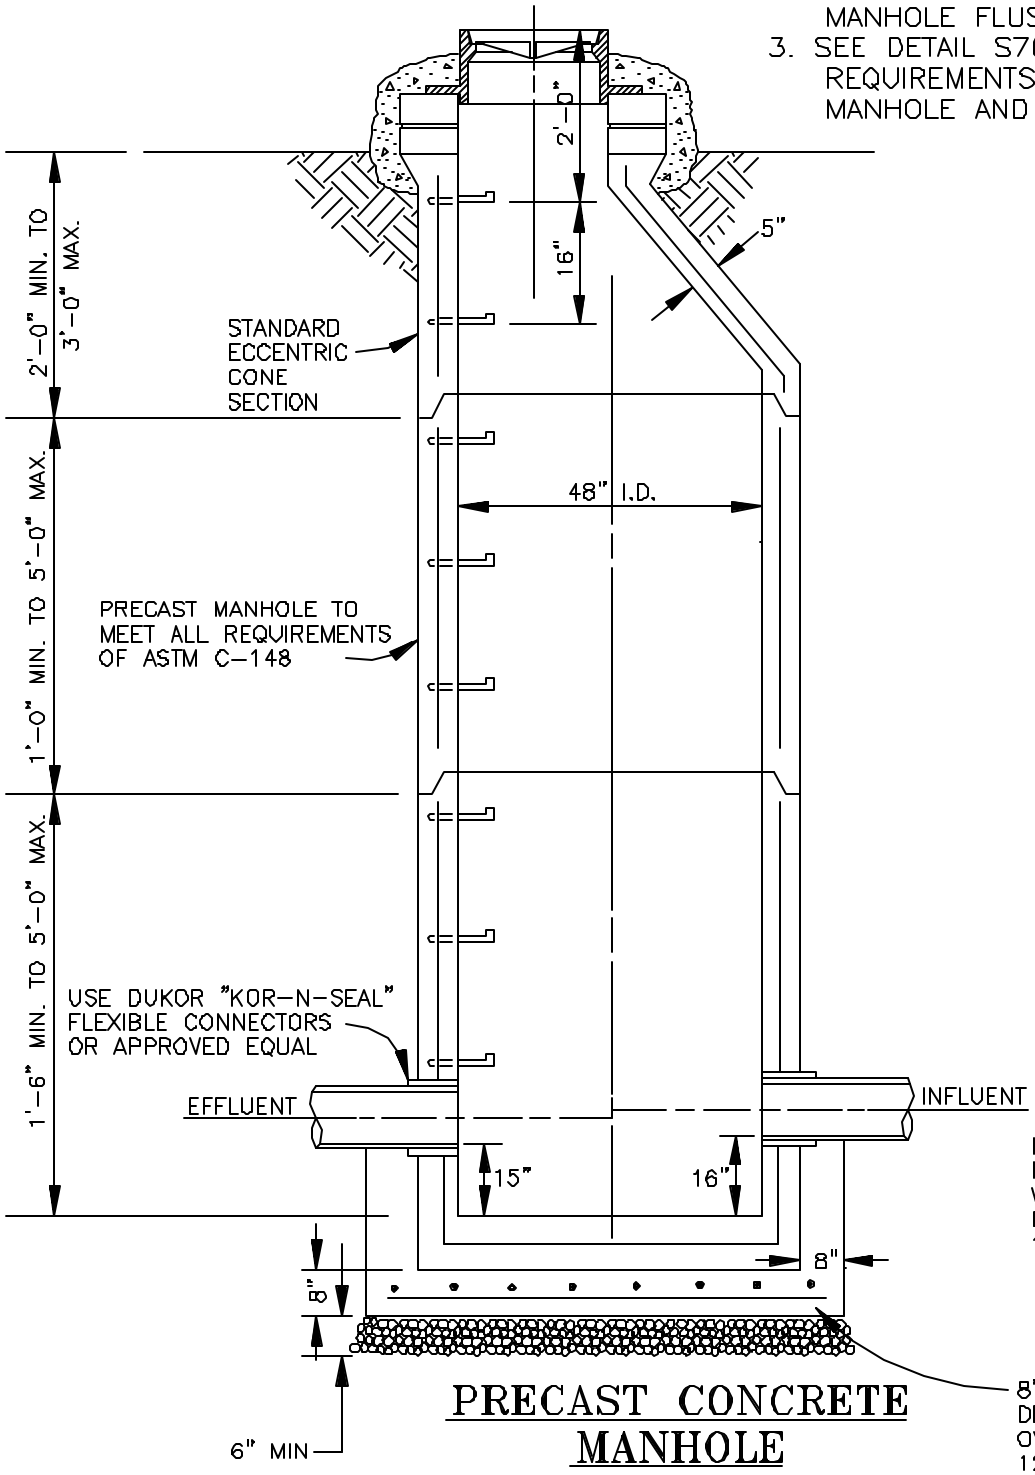

NOTE: INSIDE DROP MANHOLES ARE REQUIRED WHERE THE DROP IN ELEVATION EXCEEDS 10 FEET.

8" FOOTING REQUIRED ON DEPTHS OF 16 FEET AND OVER WITH NO.4 BARS AT 12" O.C.E.W. ON A 6" GRANULAR FOUNDATION.

PRECAST CONCRETE MANHOLE

CHEROKEE COUNTY WATER & SEWERAGE AUTHORITY	LAST MANHOLE ON SEWER LINE BEFORE WET WELL CONSTRUCTION STANDARD	DATE:	FEB. '03	STANDARD NO. S730
		APPROVED:		